



SUBMERSIBLE

Liquid Level Sensors AST4500 | AST4510

Overview

The AST4500 and AST4510 submersible liquid level sensors are approved to UL/cUL913 (CSA 157) Class I Div 1, Groups C and D for use in intrinsically safe areas with an approved barrier. It is also certified for ATEX / IECEx Class I Zone 0 Exia IIB T4 Ga (Ta = -40°C to +80°C). For pressure ranges from 0-1 to 0-100 PSI that require a wide range of media compatibility, the submersible series is an excellent solution to level monitoring for indoor and outdoor applications.

The AST4500 and AST4510 level sensors are completely sealed for submersion, yet vented through the cable to correct for barometric pressure changes. The welded housing is tested in-house via a helium leak tester to ensure proper protection. The conductors of the cable are also isolated from the outside environment to keep the sensor operational for long-term use.

With a removable nose cone, the AST4500 and AST4510 series can be also be installed outside of the tank through a 1/4" NPT pipe connection. In this configuration, the sensor continuously monitors the tank level through a threaded connection outside the tank, yet remains fully submersible for applications with flood prone environments or severe wash-down conditions. Available with voltage or 4-20mA output signals, AST can provide a cost effective solution for level monitoring for a variety of applications.

SUBMERSIBLE

AST4500 | AST4510 Liquid Level Sensors

Benefits

- High Strength Stainless Steel Construction
- No Internal O-rings
- Wide Operating Temperature
- Pressures up to 100 PSI
- Low Static and Thermal Errors
- Unparalleled Price and Performance
- New Conduit Fitting at Electrical Connection
- Survives Harsh Environments
- Compatible with Wide Variety of Liquids
- EMI/RFI Protection
- ABS (American Bureau of Shipping) Approved

Applications

- Ground Water Level
- Bio-Fuels
- Salt Water Holding Tanks
- Gasoline & Diesel Fuel Tanks
- Fertilizer Tanks
- Earthen & Concrete Dams
- Irrigation Equipment
- Ballast Tanks
- Oil Tanks
- Waste Water Canals

Performance @ 25°C (77°F)

Accuracy	< ±0.25% BFSL (<±0.5% BFSL for 0-1 PSI)
Stability (1 year)	±0.25% FS, typical
Over Range Protection	2X Rated Pressure
Burst Pressure	5X or 1,250 PSI (whichever is less)
Pressure Cycles	>50 Million

Environmental Data

Temperature

Operating	-40 to 80°C (-40 to 176°F)
Storage	-40 to 100°C (-40 to 212°F)

0-100% relative humidity, non-condensing

Thermal Limits

Compensated Range	0 to 55°C (32 to 132°F)
TC Zero	<±1.5% of FS (<±2.5%, typ. for 1PSI)
TC Span	<±1.5% of FS (<±2.5%, typ. for 1PSI)

SUBMERSIBLE

AST4500 | AST4510 Liquid Level Sensors


Other

Shock	100G, 11 msec, 1/2 sine
Vibration	10G peak, 20 to 2000 Hz.
EMI/RFI Protection:	Yes
Rating:	IP-68

Electrical Data

Output	4-20mA	1-5VDC
Excitation	10-28VDC	10-28VDC
Output Impedance	>10k Ohms	<100 Ohms, Nominal
Current Consumption:	20mA, typical	<10mA
Bandwidth	(-3dB): DC to 250 Hz	(-3dB): DC to 1kHz
Output Noise	-	<2mV RMS
Zero Offset:	<±1% of FS (<±4% 1PSI)	<±1% of FS (<±4% 1PSI)
Span Tolerance:	<±2% of FS (<±4% 1PSI)	<±1.5% of FS (<±4% 1PSI)
Output Load:	0-800 Ohms@10-28VDC	10k Ohms, min
Reverse Polarity Protection	Yes	Yes

Dimensions

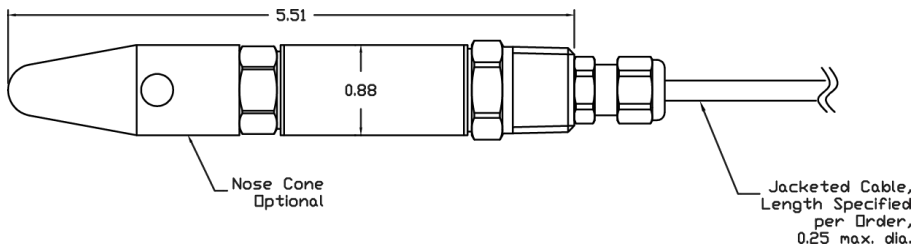

UL Approved Barrier Installation / A01657

CSA Approved Barrier Installation / A08949

Class I, Div. 1, Groups C,D
 Class I, Zone 0 Ex Ia IIB T4
 Class I, Zone 0 AEx Ia IIB T4
 DR
 Class I, Div. 1, Groups A,B,C,D
 Class I, Zone 0 Ex Ia IIC T4
 Class I, Zone 0 AEx Ia IIC T4
 Hazardous Location

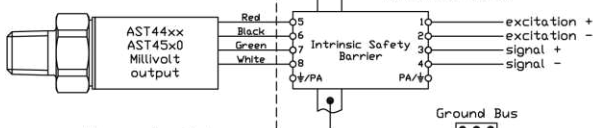


Figure 1: Wiring diagram for 4-wire, mV output

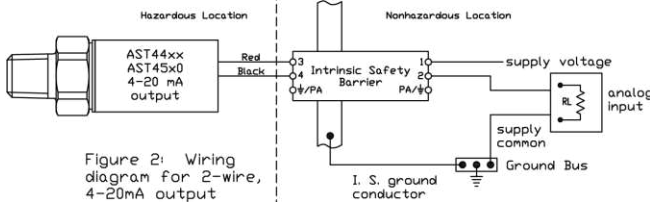


Figure 2: Wiring diagram for 2-wire, 4-20mA output

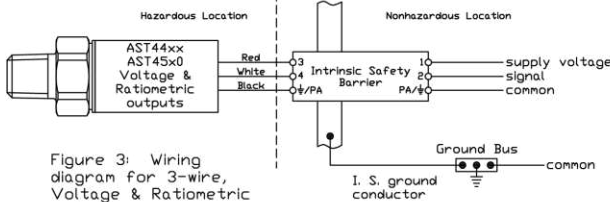


Figure 3: Wiring diagram for 3-wire, Voltage & Ratiometric outputs

Class I, Div. 1, Groups C,D
 EXia IIB, T4
 Class I, Zone 0, AEXia IIB, T4
 DR
 Class I, Div. 1, Groups A,B,C,D
 EXia IIC, T4
 Class I, Zone 0, AEXia IIC, T4
 Hazardous Location

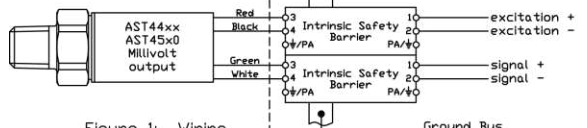


Figure 1: Wiring diagram for 4-wire, mV output

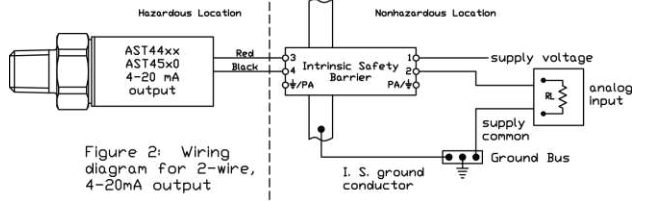


Figure 2: Wiring diagram for 2-wire, 4-20mA output

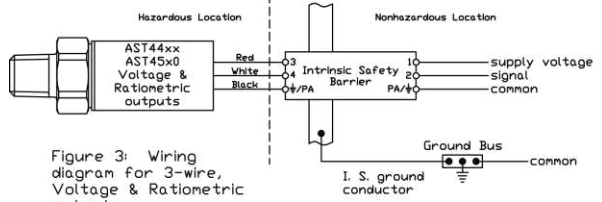


Figure 3: Wiring diagram for 3-wire, Voltage & Ratiometric outputs

The transducers listed below are designed for installation in EITHER Class I, Division 1, Groups C,D; Class I, Zone 0 Group IIB DR Class I, Division 1, Groups A,B,C,D; Class I, Zone 0 Group IIC hazardous locations when connected to Associated Apparatus as described in note 1.

Entity Parameters

Models AST4400, AST44LP, AST4500, AST4510, AST4520, AST4530
 Class I, Div. 1, Groups C,D; Class I, Zone 0 Ex Ia IIB T4; Class I, Zone 0 AEx Ia IIB T4
 $V_{max} = 28V$

Model AST4401
 Class I, Div. 1, Groups A,B,C,D; Class I, Zone 0 Ex Ia IIC T4; Class I, Zone 0 AEx Ia IIC T4
 $V_{max} = 14.5V$

4-20mA with integral connector	4-20mA with upto 1000ft of integral cable	All EXCEPT 4-20mA with integral connector	All EXCEPT 4-20mA with upto 150ft of integral cable
$P_{max} = 651 \text{ mW}$ $I_{max} = 93 \text{ mA}$ $C_i = 0.391 \text{ uF}$ $L_i = 0 \text{ uH}$	$P_{max} = 651 \text{ mW}$ $I_{max} = 93 \text{ mA}$ $C_i = 0.434 \text{ uF}$ $L_i = 0 \text{ uH}$	$P_{max} = 651 \text{ mW}$ $I_{max} = 93 \text{ mA}$ $C_i = 0.643 \text{ uF}$ $L_i = 0 \text{ uH}$	$P_{max} = 651 \text{ mW}$ $I_{max} = 93 \text{ mA}$ $C_i = 0.649 \text{ uF}$ $L_i = 0 \text{ uH}$

I_{sc} or I_o is the total current available from the Associated Apparatus under any condition.

1. The following conditions must be satisfied:

- V_{oc} or $U_o \leq V_{max}$ C_a or $C_o \geq C_i + C_{cable}$
- I_{sc} or $I_o \leq I_{max}$ L_a or $L_o \geq L_i + L_{cable}$
- $P_o \leq P_i$ (if applicable)
- Total customer cable length for 4-20mA transmitters not to exceed 4000ft.
- Total customer cable length for all other transmitters not to exceed 150ft.
- Where the cable capacitance and inductance per foot are not known, the following values shall be used: $C_{cable} = 60\text{pF/ft}$, $L_{cable} = 0.2\mu\text{H/ft}$

2. Control Room apparatus shall not generate in excess of 250V (U_{max}).

3. Canadian installations should be in accordance with Canadian Electrical Code, Part I. U.S. installations should be in accordance with Article 504 in the National Electrical Code, ANSI/NFPA 70.

Entity Parameters

Models AST4400, AST44LP, AST4500, AST4510, AST4520, AST4530
 Class I, Div. 1, Groups C,D; EXia IIB, T4; Class I, Zone 0, AEXia IIB, T4
 $V_{max} = 28Vdc$

Model AST4401
 Class I, Div. 1, Groups A,B,C,D; EXia IIC, T4; Class I, Zone 0, AEXia IIC, T4
 $V_{max} = 14.5Vdc$

4-20mA with integral connector	4-20mA with upto 1000ft of integral cable	All EXCEPT 4-20mA with integral connector	All EXCEPT 4-20mA with upto 150ft of integral cable
$P_{max} = 625 \text{ mW}$ $I_{max} = 93 \text{ mA}$ $C_i = 0.391 \text{ uF}$ $L_i = 0$	$P_{max} = 625 \text{ mW}$ $I_{max} = 93 \text{ mA}$ $C_i = 0.434 \text{ uF}$ $L_i = 155 \text{ uH}$	$P_{max} = 625 \text{ mW}$ $I_{max} = 93 \text{ mA}$ $C_i = 0.643 \text{ uF}$ $L_i = 0$	$P_{max} = 625 \text{ mW}$ $I_{max} = 93 \text{ mA}$ $C_i = 0.649 \text{ uF}$ $L_i = 23.3 \text{ uH}$

1. For installation in accordance with Fig 2, barrier must be a CSA Certified, Single Channel grounded Shunt-Diode Zener Barrier or a Single Channel Isolating Barrier.

2. For installations in accordance with Figs. 1 and 3, one dual-channel or two single-channel barriers may be used, where in either case, both channels have been certified for use together with combined entity parameters.

3. The following conditions must be satisfied:

- V_{oc} or $U_o \leq V_{max}$ C_a or $C_o \geq C_i + C_{cable}$
- I_{sc} or $I_o \leq I_{max}$ L_a or $L_o \geq L_i + L_{cable}$
- $P_o \leq P_i$ (if applicable)

4. Maximum non-hazardous area voltage must not exceed 250 V.

5. Canadian installations should be in accordance with Canadian Electrical Code, Part I. U.S. installations should be in accordance with Article 504 in the National Electrical Code, ANSI/NFPA 70.

6. A grounding method is not provided by the manufacturer as part of the integral design of the Transducer. For units which are connected through a grounded shunt diode safety barrier, ensure that the transducer is mounted to a surface which is at the same potential as the barrier ground.

7. See user manual for installation conditions.

SUBMERSIBLE

AST4500 | AST4510 Liquid Level Sensors

Ordering Information

AST4510	L	00005	P	4	N	1	000	-SS
---------	---	-------	---	---	---	---	-----	-----

Series Type

Process Connection
L= Cone A= 1/4" NPT Male P= 1/2" MNPT

Pressure Range
Insert 5-digit pressure range code. Ranges between 0-1 PSI and 0-100 PSI available. *2.5 and 7.5 PSI Sensor must be ordered in inches of H₂O.

	PSIG	Pressure Code	Feet of Water Column @ 4°C (approx.)
AST4500	0-100	00100	230.67
	0-50	00050	115.33
	0-30	00030	69.20
	0-20	00020	46.13
AST4510	0-15	00015	34.60
	0-10	00010	23.07
	0-7.5*	00208*	17.30
	0-5	00005	11.53
	0-2.5*	00069*	5.77
	0-1	00001	2.31

Pressure Unit
B= Bar K= kg/cm² H= Inches H₂O P= PSI

Outputs (contact factory for 0.5-2.5V non-ratiometric (3-5VDC))
3= 1-5V 4= 4-20mA (2 wire loop powered)

Electrical
N= Conduit fitting, Cable 6 ft.
P= Conduit fitting, Cable 10 ft.
X= Optional Length (see options)

Wetted Material
1= 316L / 304 / Hytrel Cable / Kynar Cord Grip

Options (Cable Lengths):

140= 15 ft. (4.6 m)	130= 40 ft. (12.2 m)
075= 20 ft. (6.1 m)	065= 50 ft. (15.2 m)
074= 25 ft. (7.6 m)	003= 100 ft. (30.5 m)
004= 35 ft. (10.7 m)	050= 150 ft. (45.7 m)

Approval
(Left Blank)= UL ANSI/ISA 12.12.01 Class I Div 1 Intrinsically Safe Groups C, D (formerly UL913)
-SS= CSA157 Class I Div 1 Grps C, D Intrinsically Safe, ANSI/ISA 12.27.01 Single Seal and ATEX/IECEx Exia IIC Class I, Zone 0, T4

Note: CSA approved products require case/earth ground electrical connection. See wiring installation sheet for further details

联系方式



深圳市亿为测控电子有限公司
Shenzhen Bill-Well Measurement & Control Electronics Co., Ltd.

地址: 深圳市南山区创业路怡海广场东座 2408 邮编: 518000
电话: (+86) 0755 2641 9890 传真: (+86) 0755 2641 9680
电子邮箱: sales@bill-well.com